


**Addendum
Addenda**

No./No 1

Project Description / Description de projet S77 Room B12 PD5, PD2 and PD6 Electrical Panel Replacements/S77 Salle B12 PD5, PD2 et PD6		
Project No./No de projet 6295	Departmental Representative / représentant ministériel Mark O'Connor	Date 12-Jul-2023
Solicitation No./N° de sollicitation 23-58051		
Notice: This addendum shall form part of the tender documents and all conditions shall apply and be read in conjunction with the original plans and specifications.		
Nota: Cet addenda fait partie intégrale des dossiers d'appel; toutes les conditions énoncées doivent être lues et appliquées en conjonction avec les plans et les devis originaux.		

Item No	Description
1	Reissue drawing 6295-E02 Réémission du dessin 6295-E02
2	Site Visit Attendance Visite de chantier

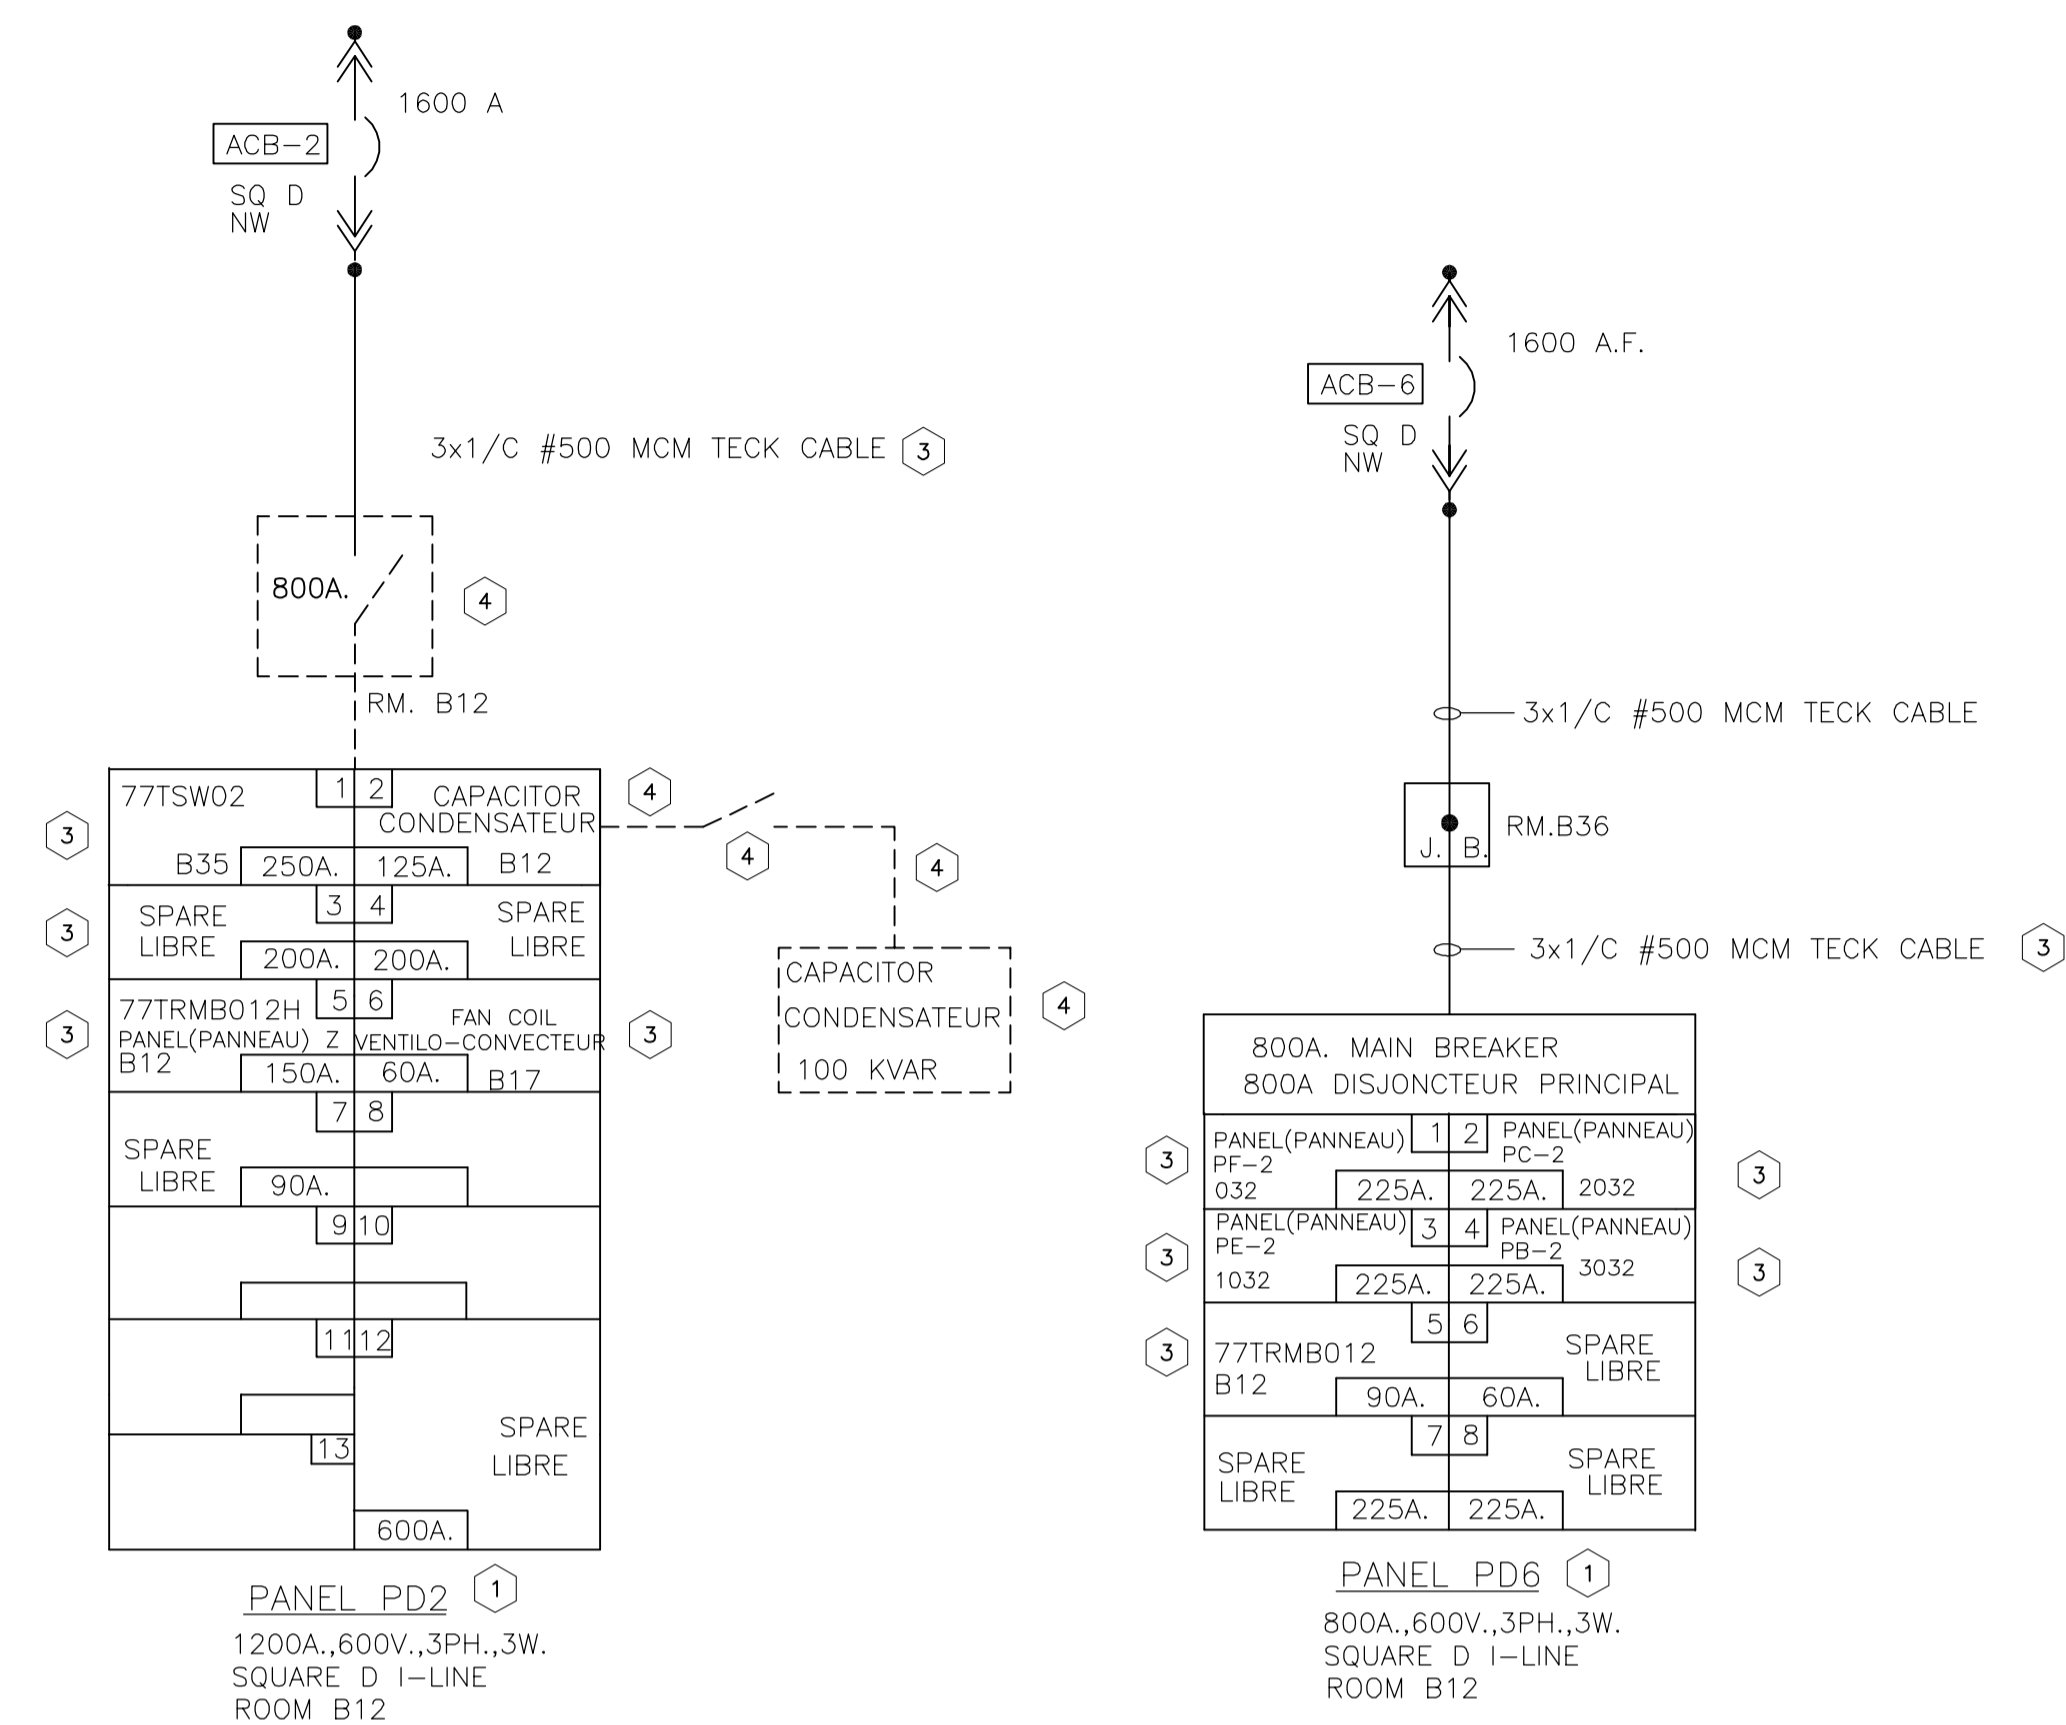


EXISTING SINGLE LINE DIAGRAM
 DIAGRAMME EXISTANTE À UNE LIGNE

NOTES:


- DISCONNECT AND REMOVE EXISTING PANEL, RETURN BREAKERS TO NRC.
- PROVIDE NEW PANEL WITH BREAKERS AND ON BOARD CONTROL POWER SUPPLY TO TRIP UNITS. - TRIP UNIT SETTING TO BE PROVIDED BY NRC, SET UP BY CONTRACTOR.
- REINSTATE CONNECTION TO EXISTING FEEDER. PROVIDE ADDITIONAL WIRE AND SPLICE AS REQUIRED.
- DISCONNECT AND REMOVE EXISTING EQUIPMENT AND WIRING.

NOTES:

- DÉBRANCHER ET ENLEVER LE PANNEAU EXISTANT, RETOURNER LES DISJONCTEURS AUX NRC.
- FOURNIR UN NOUVEAU PANNEAU AVEC DES DISJONCTEURS ET ALIMENTATION DE CONTRÔLE EMBARQUÉE POUR LES UNITÉS DE DÉCLENCHEMENT. - LE RÉGLAGE DE L'UNITÉ DE DÉCLENCHEMENT SEARS FOUNI PAR LE CNRC ET MIS EN PLACE PAR L'ENTREPRENEUR.
- RÉTABLIR LA CONNEXION À L'ALIMENTATEUR EXISTANTE. FOURNIR DES FILS SUPPLÉMENTAIRES ET DES ÉPISURES SI NÉCESSAIRE.
- DÉCONNECTER ET ENLEVER L'ÉQUIPEMENT ET LE CÂBLAGE EXISTANTS

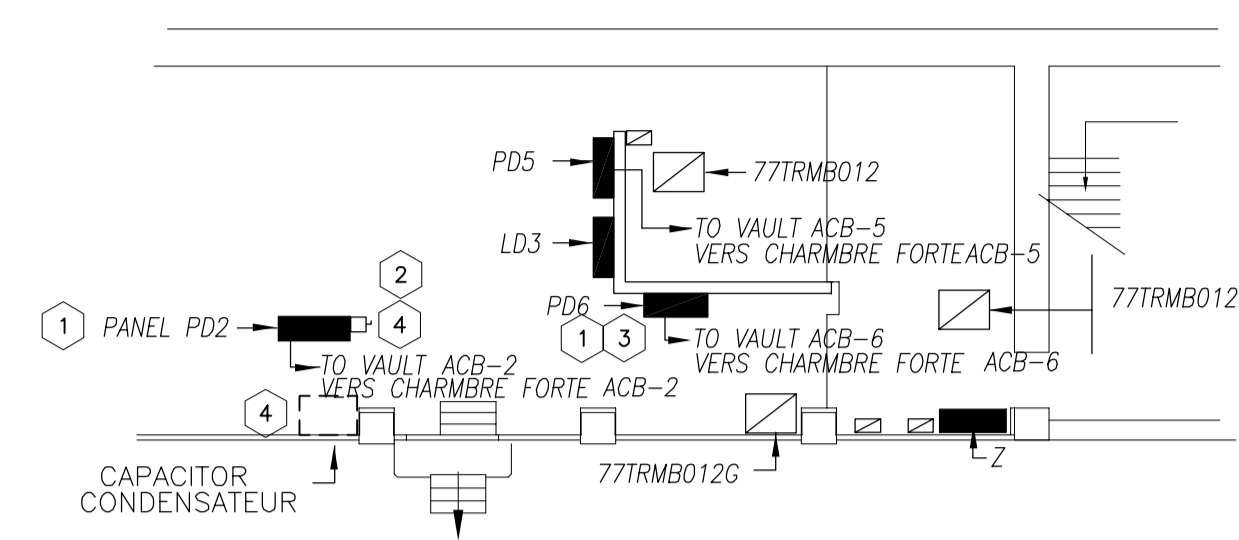

B12 PARTIAL FLOOR PLAN
 PLAN D'ÉTAGE B12 PARTIEL
 SCALE(ÉCHELLE) = 1:125

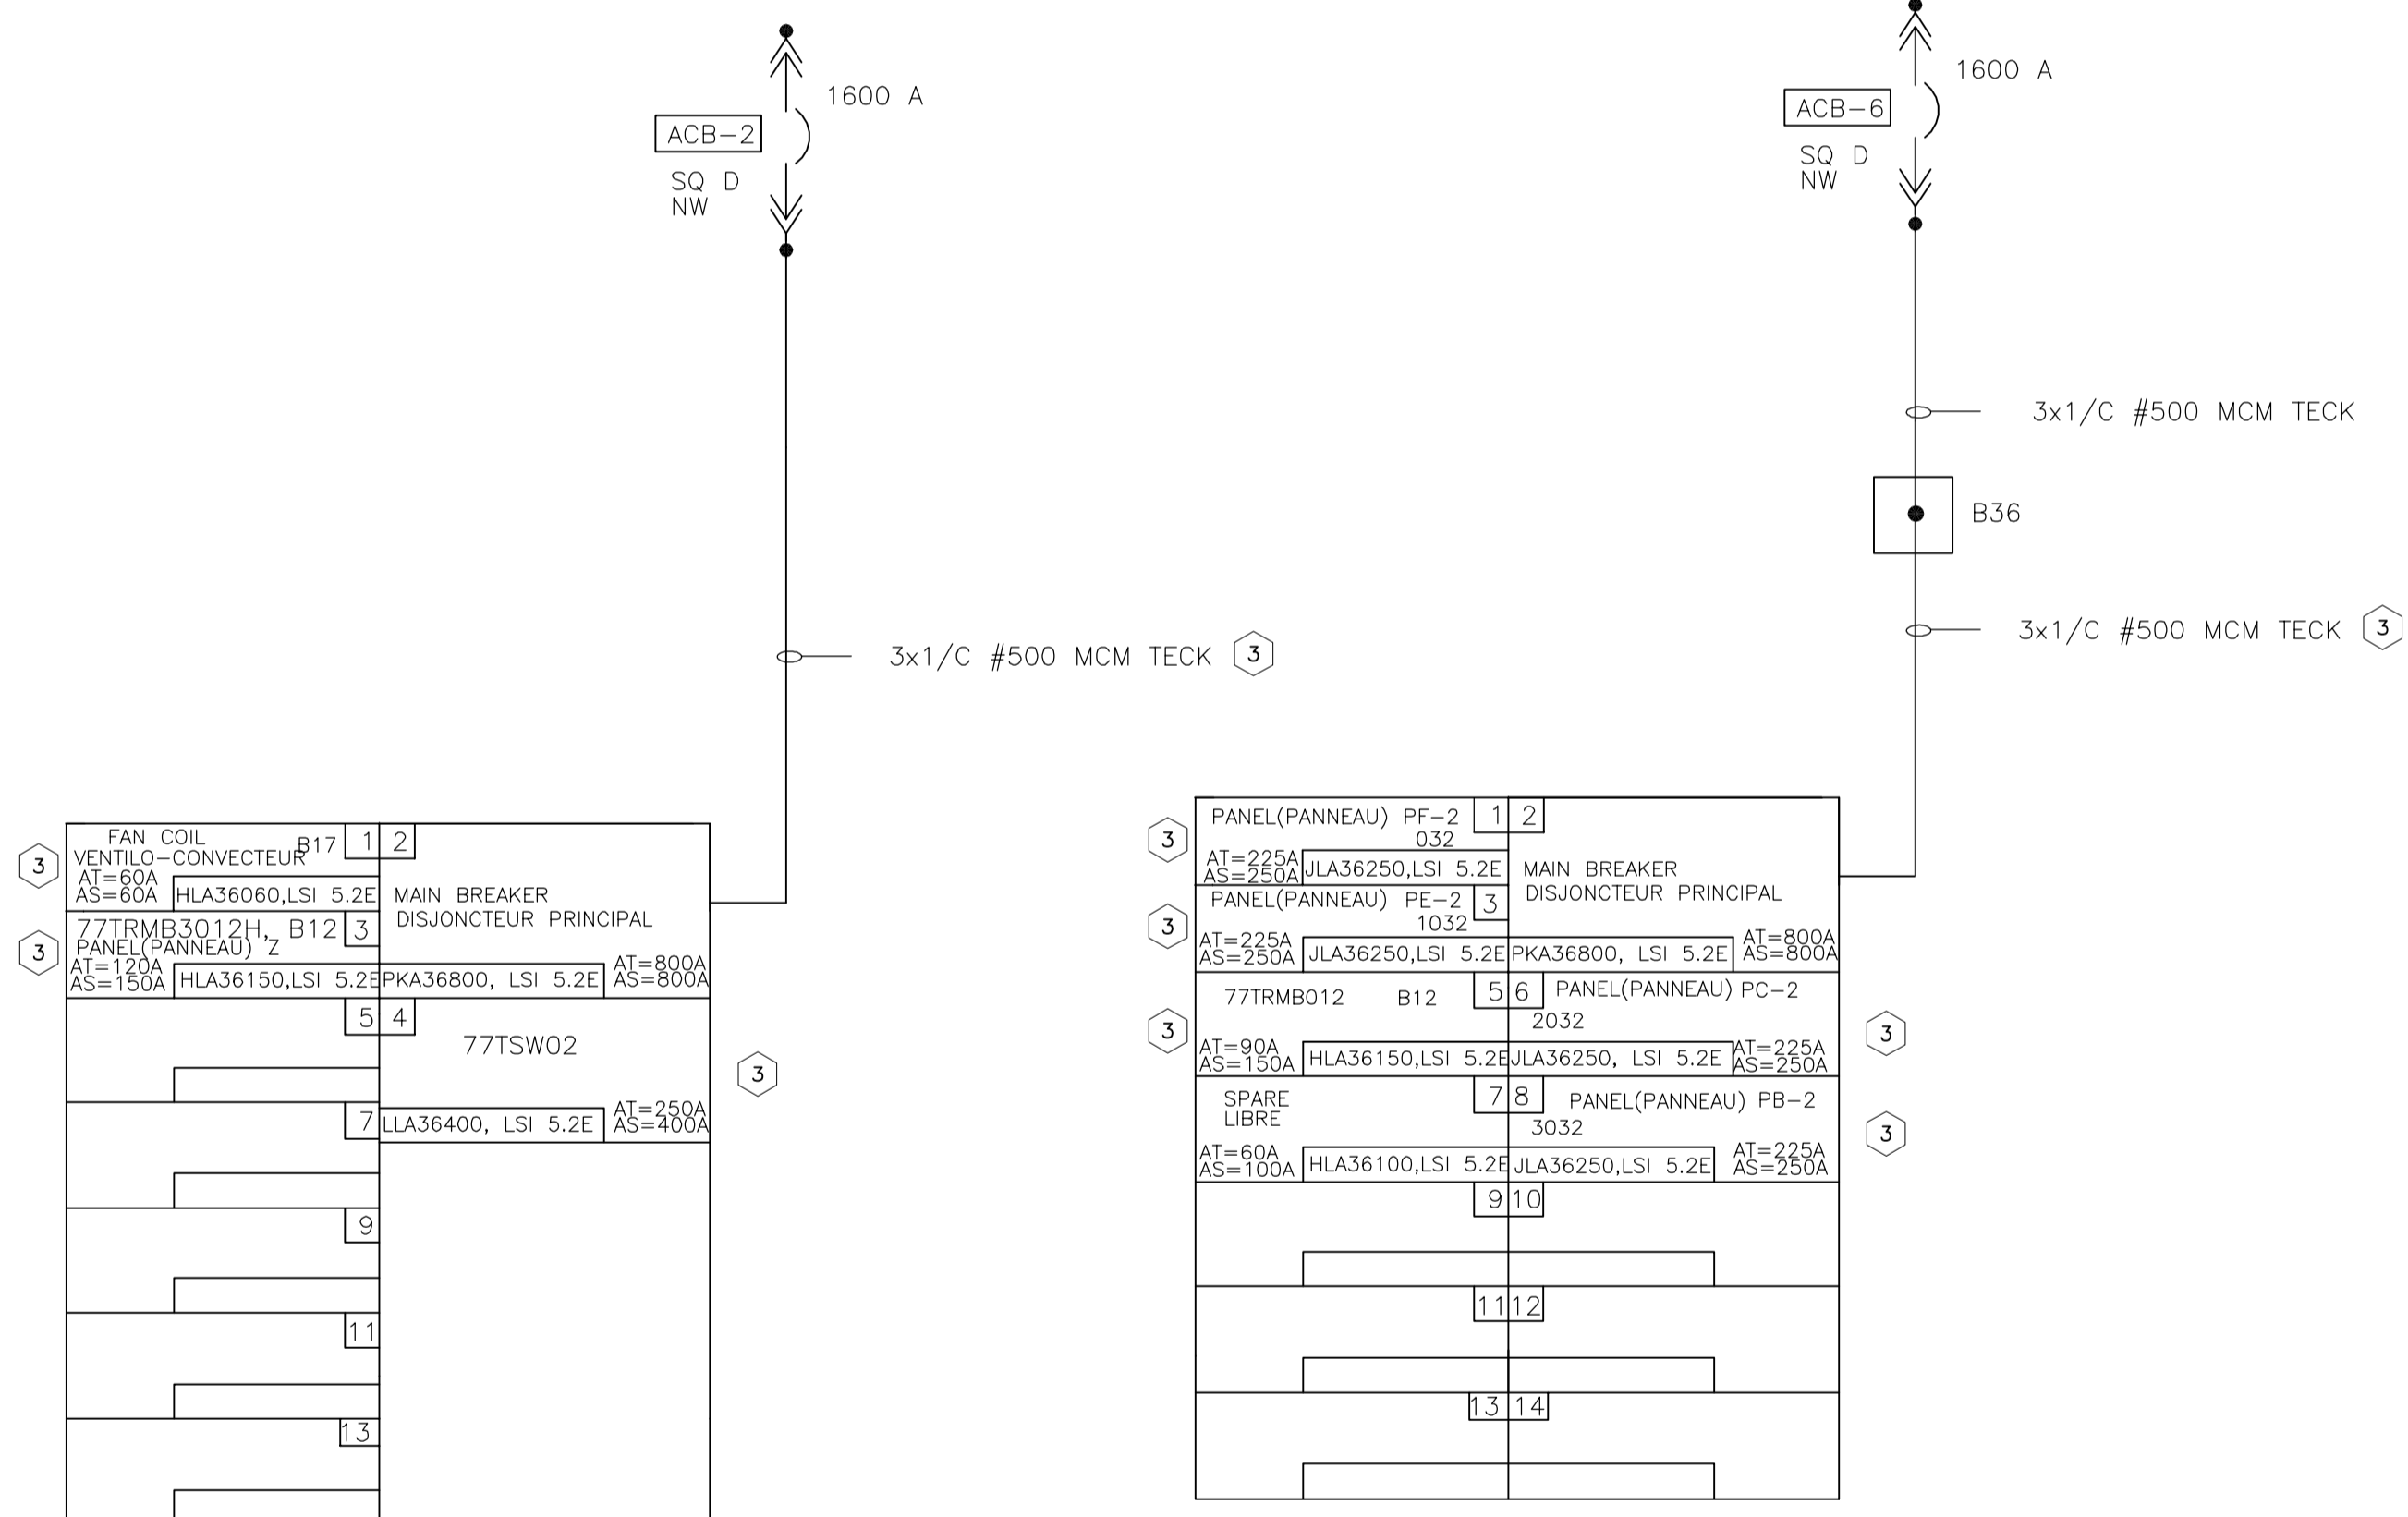

PANEL/PANNEAU PD2
 800A., 600V., 3PH., 3W. 50KA@600V
 SQUARE D I-LINE ROOM B12

PANEL/PANNEAU PD6
 800A., 600V., 3PH., 3W. 50KA@600V
 SQUARE D I-LINE ROOM B12

NEW SINGLE LINE DIAGRAM
 NOUVEAU DIAGRAMME À UNE LIGNE

- NOTES GÉNÉRALES
- L'ENTREPRENEUR DOIT VÉRIFIER TOUTES LES DIMENSIONS ET LES DÉGAGEMENTS SUR LE CHANTIER AVANT D'ENTREPRENDRE LES TRAVAUX DE CONSTRUCTION ET AVISER LE REPRÉSENTANT DU MINISTÈRE DE TOUTE DIVERGENCE OU DE TOUTE OMISSION.
 - LES ENTREPRENEURS DOIVENT VISITER LE CHANTIER ET SE FAMILIARISER PLEINEMENT AVEC LA PORTÉE DES TRAVAUX AVANT LE DÉBUT DU PROJET.
 - TOUS LES CORPS DE MÉTIER DOIVENT COORDONNER LES TRAVAUX SUR LE CHANTIER, AVEC L'APPROBATION DU REPRÉSENTANT DU MINISTÈRE, AFIN D'ÉVITER LES CONFLITS OU LES INTERFÉRENCES.
 - TOUS LES ARRÊTS DE SERVICE NÉCESSAIRES DOIVENT ÊTRE COORDONNÉS AVEC LE REPRÉSENTANT DU MINISTÈRE.
 - L'INSTALLATION DE TOUTS LES SYSTÈMES DOIT S'EFFECTUER CONFORMÉMENT AUX CODES ET AUX NORMES EN VIGUEUR.
 - L'ENTREPRENEUR EST RESPONSABLE DE LA REMISE EN ÉTAT ET DE LA RÉPARATION DE TOUT DOMMAGE CAUSÉ PAR LES TRAVAUX.
 - L'ENTREPRENEUR DOIT EMPÊCHER LA POUSSIÈRE ET LES DÉBRIS DE SE PROPAGER AU-DÈLA DE L'AIRES DES TRAVAUX ET NETTOYER TOUTES LES SURFACES UNE FOIS LES TRAVAUX TERMINÉS.

- GENERAL NOTES
- CONTRACTOR TO VERIFY ALL DIMENSIONS AND CLEARANCES ON SITE PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES AND/OR OMISSIONS TO DEPARTMENTAL REPRESENTATIVE.
 - CONTRACTORS MUST VISIT THE SITE AND FULLY FAMILIARIZE THEMSELVES WITH THE SCOPE OF THE WORK PRIOR TO PROJECT COMMENCEMENT.
 - ALL TRADES TO COORDINATE WORK ON SITE, WITH APPROVAL OF DEPARTMENTAL REPRESENTATIVE TO AVOID ANY CONFLICTS AND/OR INTERFERENCE.
 - ANY AND ALL REQUIRED SHUTDOWNS SHALL BE COORDINATED WITH DEPARTMENTAL REPRESENTATIVE.
 - INSTALLATION OF ALL SYSTEMS SHALL BE IN ACCORDANCE WITH APPLICABLE CODES AND STANDARDS.
 - CONTRACTOR TO BE RESPONSIBLE FOR REINSTATEMENT AND REPAIR OF ANY DAMAGE CAUSED BY WORK.
 - CONTRACTOR SHALL PREVENT THE SPREAD OF DUST AND DEBRIS BEYOND AREA OF WORK AND CLEAN ALL SURFACES AT COMPLETION.
 - ALL SHUTDOWNS SHALL BE PERFORMED AFTER NORMAL WORKING HOUR.
 - INFILL NEW OPENING THROUGH THE FLOOR WITH FIRE RATED ROXUL INSULATION AND SELF-LEVELING FIRE RETARDANT


KEY PLAN PLAN CLÉ



No.	Date	Revision	By:
1	07 12 2023	ISSUED FOR ADDENDUM #1/EMIS POUR ADDENDUM #1	KXL
0	06 20 2023	ISSUED FOR TENDER/EMIS POUR OFFRES	KXL

Date Printed 00 MM YYYY Date imprimée

- Verify all dimensions and site conditions and be responsible for same
- Vérifier toutes les dimensions et l'état des lieux et en assumer la responsabilité

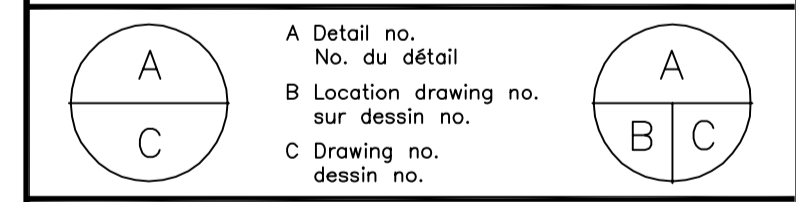

project ROOM B12 PANELS REPLACEMENT
 REMPLACEMENT DES PANNEAUX DE LA CHAMBRE B12
 SUSSEX ROAD CAMPUS
 CAMPUS DE LA RUE DE SUSSEX

drawing PD2, PD6 SINGLE LINE DIAGRAM AND FLOOR PLAN
 PD2, PD6 DIAGRAMME À UNE LIGNE ET PLAN D'ÉTAGE


designed	conçu	date	date
KXL		06/2023	
drawn	dessiné	scale	échelle
KXL		AS NOTED/ COMME INDIQUÉ	
checked	vérifié	sheet	feuille
MR		E02 of/de	E02
approved	approuvé	W.O.no.	D.T.no.
FG			







dwg.no. 6295-E02 dessin no.

Mandatory Site Visit Attendance / Visite de chantier obligatoire




Project Description / Description de projet
 S77 Room B12 PD5, PD2 and PD6 Electrical Panel Replacements/S77 Salle B12 PD5, PD2 et PD6 Remplacement des panneaux électriques

Solicitation No./N° de sollicitation 23-58051 Project No./No de projet 6295

Departmental Representative / représentant Mark O'Connor Signature 

COMPANY/ENTREPRENEUR	NAME/NOM	SIGNATURE	PHONE/TELEPHONE	EMAIL/COURRIEL	Alternate / Substituts	Question	1st Showing / 1er visite	2nd Showing / 2ieme visite	Closing Date / Date de fermeture
LAFRANBOISE GROUT	KEE WOODS		613 577-2769	rwwoods@lafranboise.com	July 18, 2023	July 25, 2023	July 11, 2023	July 12, 2023	August 1, 2023
Carleton electric	Brian Marsh		613 850 0104	bmarsh@carltonelectric.com	July 18, 2023	July 25, 2023	July 11, 2023	July 12, 2023	2:00 PM
Bader Electric	Trevor MacDonald		613-915-5003	Trevor@Bader-electric.ca	July 18, 2023	July 25, 2023	July 11, 2023	July 12, 2023	10:00 AM
Black & McDonald Limited	Yac Chen		416-838-0309	ychen@blackandmcdonald.com	July 18, 2023	July 25, 2023	July 11, 2023	July 12, 2023	
SEGURIO MCKRIS	ERIC TRIVETT		503-218-3042	ETRIVETT@SEGURIOHARRIS.COM	July 18, 2023	July 25, 2023	July 11, 2023	July 12, 2023	
Segin Morris	Luc Joly		819-635-2805	Ljoly@seginmorriss.com	July 18, 2023	July 25, 2023	July 11, 2023	July 12, 2023	

Mandatory Site Visit Attendance / Visite de chantier obligatoire

Project Description / Description de projet S77 Room B12 PD5, PD2 and PD6 Electrical Panel Replacements/S77 Salle B12 PD5, PD2 et PD6 Remplacement des panneaux électriques		Closing Date / Date de fermeture August 1, 2023 2:00 PM	
Solicitation No./N° de sollicitation 23-58051		Project No./No de projet 6295	
Departmental Representative / représentant Mark O'Connor		Signature 	
COMPANY/ENTREPRENEUR		NAME/NOM	
Ever Yell		Pierrestette	
Modern Niagara		Matthew Husko	
SIGNATURE		PHONE/TELEPHONE	
		613 223 2172	
		613-914-9028	
EMAIL/COURRIEL		Question	
Pierrestette@electrical.ca		July 25, 2023	
Matthew.Husko@modernniagara.com			
1st Showing / 1er visite July 11, 2023 10:00 AM		2nd Showing / 2ieme visite July 12, 2023 10:00 AM	

